

Applying The Germanium Balancing Test

Written by Administrator

Monday, 21 September 2009 20:24 - Last Updated Monday, 09 August 2010 00:13

A Simple Germanium Balancing Test



-

Interlock all fingers from both hands tightly behind your back

-

Stand with both feet slightly apart and ensure the soles of your feet are also flat on a level floor.

- Keep your knees locked to present a stiff standing posture.

-

Ask someone standing behind to apply a downward force on your interlocked fingers until the tendency to topple backwards happens.

-

However if you are wearing a high purity Germanium product, your body will experience a very significant change in resisting the downward force, that means not toppling, than without the presence of a Germanium product on your body.

Applying The Germanium Balancing Test

Written by Administrator


Monday, 21 September 2009 20:24 - Last Updated Monday, 09 August 2010 00:13

-

Your body will only experience the balancing effect if the purity of the Germanium is at least 99.9%.

- Always insist on doing this simple test on the actual product you are purchasing as it will assure you of getting a quality product with high purity Germanium like our Amglo, BH Plus, and Vital-ion Germanium products.

- Do not be fooled by salesmen selling a germanium product that is not tested/validated by this simple balancing test.

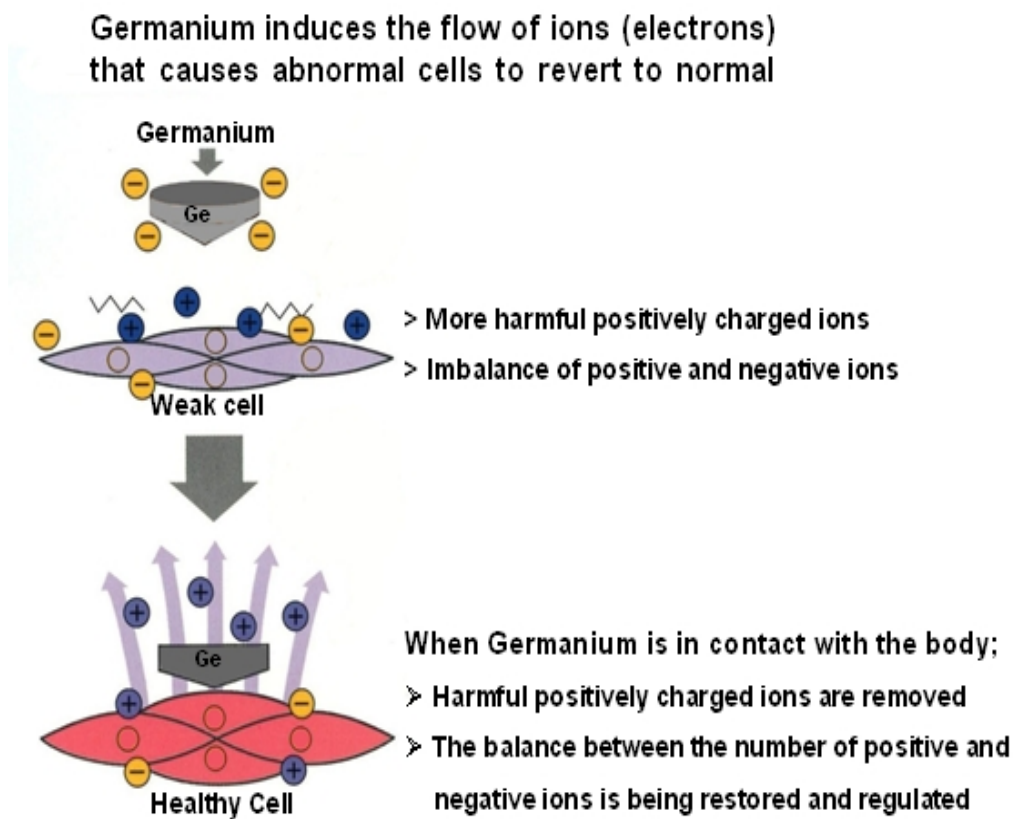

If the Germanium purity is less than 99.9%, the flow of ions will not be induced.

Applying The Germanium Balancing Test

Written by Administrator

Monday, 21 September 2009 20:24 - Last Updated Monday, 09 August 2010 00:13

The importance of balancing positive and negative ions (electrons) in the body



Fatigue and discomfort

Refresh and invigorated

Body with more positive ions than negative ions

Body with the balance of positive and negative ions

~~Copyright © 2009 by the author. All rights reserved. This document is the property of the author and is not to be distributed, copied, or reproduced in any form without the author's written permission.~~